



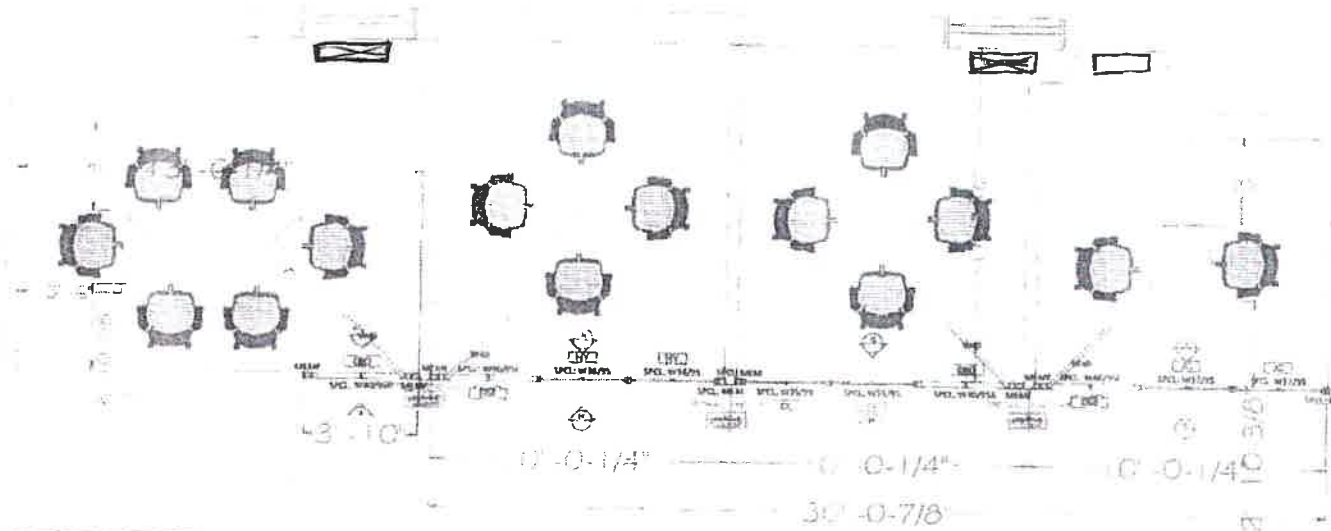

OPTION 3

BASED CONSOLE UNIT AS PART OF INITIAL BID

55CFM
FROM
AHU-3A
TO
2x2
DIFFUSER
DUCT SIZE
TO BE 5"φ

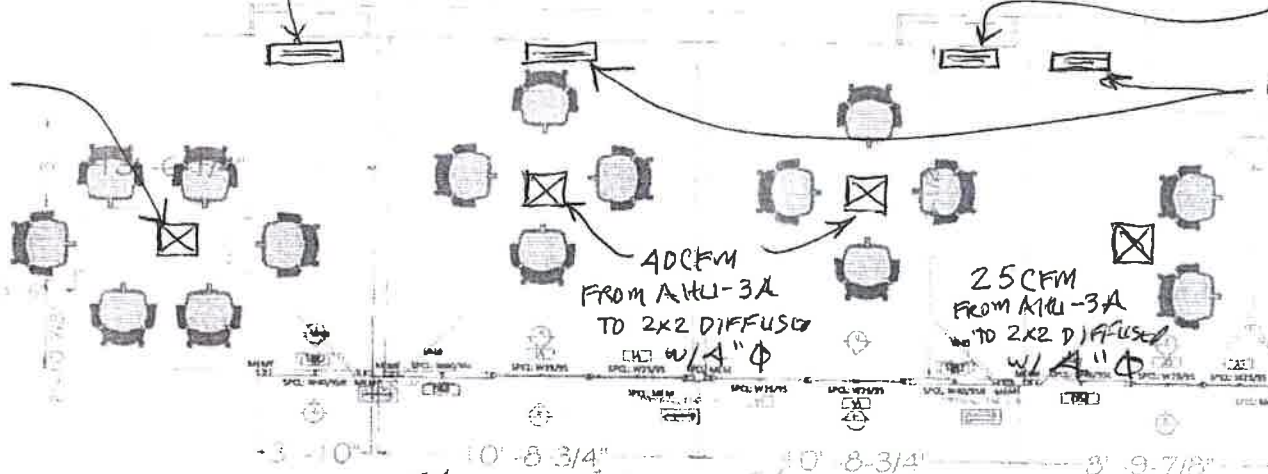

NEW CONSOLE
LIMITS
CASED
& CONNECTED
TO HP-8

40CFM
FROM AHU-3A
TO 2x2 DIFFUSER
w/ 4"φ

25CFM
FROM AHU-3A
TO 2x2 DIFFUSER
w/ 4"φ

Changed to 10'-6" Changed

Changed - 9'

option 4 approved JUN 2/28/24

MCE - HYAC

3-14-2024

Addendum #5

TOWN OF NEWTON CH BOOTH

3-14-2024